


IMPERIOUZ AUTO BODY

2851 LASITER LANE, TURLOCK, CA 95380

VICINITY MAP:



BUILDING & PROPERTY INFO:

APN: 044-055-005
ZONING: (I) INDUSTRIAL
LEGAL DESCRIPTION: LOT 6 OF WESTSIDE INDUSTRIAL PARK, ACCORDING TO THE OFFICIAL MAPS THEREOF, FILED IN THE OFFICE OF THE RECORDER, STANISLAUS COUNTY, CALIFORNIA ON MARCH 25, 1981 IN VOL. 29 OF MAPS, AT PAGE 88 & 24,604 S.F.
LOT AREA:
CONSTRUCTION TYPE: II-B
OCCUPANCY: S1, B
EXISTING USE: AUTO BODY
PROPOSED USE: AUTO BODY & PAINT

BUILDING AREA: 6,600 S.F. (NO CHANGE)

OFFICE AREA (B): 2,050 S.F.
SHOP AREA (S1): 4,540 S.F.

FIRE SPRINKLERS: NO

PROJECT VALUATION: \$40,000.00

STORIES: 1
BUILDING HEIGHT: 18'-6"
ALLOWABLE HEIGHT PER CBC 504.3: 55'-0"
ALLOWABLE FLOOR AREA PER 505.2.2 (EQUATION 5-1):

$$A_n = [A_1 + (N \times I_n)]$$

A₁ OFFICE (B) = 23,000
A₁ SHOP (S1) = 17,500

$$23,000 + (23,000 \times 0) = 23,000 \text{ S.F.}$$

$$2,050 / 23,000 = .089$$

$$17,500 + (17,500 \times 0) = 17,500 \text{ S.F.}$$

$$4,540 / 17,500 = .259$$

$$.089 + .259 = .348 < 1 \text{ ALLOWABLE AREA IS OK}$$

CODES IN EFFECT:

2022 CALIFORNIA BUILDING CODE
2022 CALIFORNIA ELECTRICAL CODE
2022 CALIFORNIA MECHANICAL CODE
2022 CALIFORNIA PLUMBING CODE
2022 CALIFORNIA FIRE CODE
2022 CALIFORNIA ENERGY CODE
2022 CALIFORNIA GREEN BUILDING CODE

PROJECT DIRECTORY:

PROJECT ENGINEER:
JAMES FOX ENGINEERING
851 PANARAMA RD.
FULLERTON, CA 92631
TEL: (714) 423-5047
LICENSE: 21543

SCOPE OF WORK:

1. MINOR DISCRETIONARY PERMIT TO ALLOW THE INSTALLATION OF (1) PAINT SPRAY BOOTH AND (1) PAINT MIX ROOM.
2. RESTRIPE PARKING TO ADD (1B) PARKING SPACES INCLUDING (1) VAN ACCESSIBLE SPACE, ACCESS AISLE AND SIGNAGE.
3. INSTALL (1) 2-BIKE BICYCLE RACK AND CONCRETE PAD.
4. INSTALL MESH SCREEN ON EXISTING CHAIN-LINK FENCE.
5. INSTALL ILLUMINATED BUILDING ADDRESS SIGN.

PROJECT NOTES:

1. THE GENERAL CONTRACTOR AND ALL SUBCONTRACTORS SHALL VERIFY ALL DIMENSIONS AND JOB SITE CONDITIONS PRIOR TO BEGINNING OF CONSTRUCTION AND SHALL REPORT ANY DISCREPANCIES IMMEDIATELY TO THE DESIGNER.
2. ALL WORK SHALL COMPLY WITH THE CALIFORNIA BUILDING CODE 2022 EDITION.
3. CONTRACTOR SHALL CONFORM TO THE CONSTRUCTION AND DEMOLITION DEBRIS PER LOCAL ORDINANCE.
4. CONTRACTOR SHALL COMPLY WITH ALL OSHA REQUIREMENTS.

SPRAY BOOTH NOTES:

1. A DRY CHEMICAL FIRE SUPPRESSION SYSTEM IS REQUIRED FOR THE SPRAY BOOTH AND PAINT MIX ROOM AND SHALL BE UNDER A SEPARATE DEFERRED PERMIT.
2. A FIRE ALARM MONITORING SYSTEM IS REQUIRED FOR THE SPRAY BOOTH AND PAINT MIX ROOM AND SHALL BE UNDER A SEPARATE DEFERRED PERMIT.
3. CONSTRUCTION OF THE SPRAY BOOTH IS REGULATED BY THE CURRENT CALIFORNIA BUILDING CODE, SECTION 416.4 AND THE CURRENT CALIFORNIA FIRE CODE:

"416.4 SPRAY BOOTHS: SPRAY BOOTHS SHALL BE DESIGNED, CONSTRUCTED AND OPERATED IN ACCORDANCE WITH THE CALIFORNIA FIRE CODE."

"2404.3.3 SPRAY BOOTHS: THE DESIGN AND CONSTRUCTION OF SPRAY BOOTHS SHALL BE IN ACCORDANCE WITH SECTIONS 2404.3.3.1 THROUGH 2404.3.3.6, SECTIONS 2404.4 THROUGH 2404.6 AND NFPA 33."

4. 2404.3.3.6 SIZE: THE AGGREGATE AREA OF SPRAY BOOTHS IN A BUILDING SHALL NOT EXCEED THE LESSER OF 10 PERCENT OF THE AREA OF ANY FLOOR OF A BUILDING OR THE BASIC AREA ALLOWED FOR A GROUP H-2 OCCUPANCY WITHOUT AREA INCREASES, AS SET FORTH IN THE CALIFORNIA BUILDING CODE. THE AREA OF AN INDIVIDUAL SPRAY BOOTH IN A BUILDING SHALL NOT EXCEED THE LESSER OF THE AGGREGATE SIZE LIMIT OR 1,500 SQUARE FEET (139 M²). EXCEPTION: ONE INDIVIDUAL BOOTH NOT EXCEEDING 500 SQUARE FEET (46 M²)

BUILDING AREA: 6,600 S.F.
MAX ALLOWABLE SPRAY BOOTH AREA: 6,600 X 10% = 660 S.F.
TOTAL SPRAY BOOTH AREA: 392 S.F.
SPRAY BOOTH AREA BELOW MAXIMUM: 660 S.F. > 392 S.F.

SHEET INDEX:

ARCHITECTURAL PLANS:

- C1. COVER SHEET, PROJECT INFO & NOTES
- GN1. GENERAL NOTES
- GN2. ACCESSIBILITY NOTES
- CG1. CAL GREEN BUILDING NOTES
- CG2. CAL GREEN BUILDING NOTES
- CG3. CAL GREEN BUILDING NOTES
- A1. EXISTING SITE PLAN
- A2. PROPOSED SITE PLAN
- A3. EXISTING FLOOR PLAN
- A4. PROPOSED FLOOR PLAN
- A5. EXISTING & OCCUPANCY PLAN
- A6. PROPOSED ROOF PLAN
- A7. EXTERIOR ELEVATIONS
- A8. COLOR RENDERINGS
- AD1. ACCESSIBLE PARKING PLAN & SITE DETAILS

EQUIPMENT PLANS:

- EQ1. NOTES: GENERAL, FIRE & MECHANICAL
- EQ2. NOTES: ELECTRICAL
- EQ3. NOTES: PAINT MIX ROOM
- EQ4. EQUIPMENT PLAN, ELEVATIONS & NOTES
- EQ5. EQUIPMENT DETAILS

DATE	DESCRIPTION	DATE	DESCRIPTION
04/28/23	MAJOR DISCRETIONARY PERMIT		

Project For: IMPERIOUZ AUTO BODY
2851 LASITER LANE
TURLOCK, CA 95380

Prepared By: ROTHBERG INC.
1162 WEST ST.
GARDEN GROVE, CA 92640
TEL: (714) 546-6670
EMAIL: rmy@rothberg.com

STAMP
JAMES FOX ENGINEERING
5/24/23

SHEET TITLE:
COVER SHEET, PROJECT
INFO & NOTES

DATE: 04/28/23
SCALE: AS NOTED
DRAWN: P. ORTEGO
JOB: -
SHEET NO.
C1

[illegible][illegible]

2. CONTRACTOR AND DESIGNER TO BE A PROPER CLASH ANALYSIS OF PARTITION LAYOUT PRIOR TO COMMENCEMENT OF PARTITION CONSTRUCTION.
3. FIELD MEASURE AS REQUIRED FOR ALL GAZING AND MILLING CONDITIONS PRIOR TO FABRICATION.
4. VERIFY STUD AND WALL MATERIALS TO CONSTRUCTION SPECIFICATIONS.
5. ALL PENETRATIONS AT FLOOR CONSTRUCTION SHALL BE PROTECTED TO MAINTAIN RATING.
6. VERIFY ALL PARTITION WALLS TO CONSTRUCTION SPECIFICATIONS. CONTRACTOR TO VERIFY ACTUAL DEPTH REQUIRED, AND OVERDEPTHS SHALL BE REPORTED TO THE DESIGN.
7. ALL WATER RESISTANT CURTAIN BOARD AT ALL AREAS SUBJECT TO MOISTURE OR WHERE ICE IS USED.
8. ALL HOT WATER RADIANT SHALL BE PROPERLY ISOLATED SEE FLOWING DRAWINGS.
9. ALL FLOORING WORK SHALL BE IN ACCORDANCE WITH LOCAL AND NATIONAL CODES.
10. OPEN SPACINGS IN PARTITIONS NOT OVERSIZED ARE TO BE LOCATED AT FLOOR ADJACENT PARTITIONS.
11. ALL FLOORING TO BE PROVIDED TO BE CERTAIN STANDARD.
12. CONTRACTOR TO FURNISH A TIGHTLY SEALED GALVANIZED METAL WALL BACKING AT ALL BUILD-IN NECESSARY LOCATIONS, HANGING WALL EQUIPMENT.
13. CONTRACTOR TO PROVIDE A TIGHTLY SEALED GALVANIZED METAL WALL BACKING AT ALL BUILD-IN NECESSARY LOCATIONS, HANGING WALL EQUIPMENT.
14. VERIFY ALL APPLIANCE & EQUIPMENT REQUIREMENTS WITH MANUFACTURERS. PREVENT ALL UNNECESSARY WALL BACKING, BRACING, ELECTRICAL & MECHANICAL.
15. UNLESS OTHERWISE NOTED, ALL CURTAIN BOARD SURFACES, WALLS, AND CEILINGS SHALL BE TAPED AND FEATHERED SMOOTH TO RECEIVE A MINIMUM OF TWO COATS OF PAINT TO BE SPECIFIED.
16. PREPARE ALL FLOORS AS REQUIRED TO RECEIVE NEW FURNISHES.

2. COORDINATE TELEPHONE/DATA INFILTRATION WITH APPROPRIATE SUB-CONTRACTOR

ALL TELEPHONE AND DATA CABLE TO BE TIEFOLD COATED PLUNGED RATED CABLE. SUPPORTED INDIVIDUALLY FROM SUSPENDED CEILING SYSTEM.

3. WIRING TO BE COORDINATED BY ELECTRICAL CONTRACTOR

ALL OUTLETS TO BE INSTALLED AT LOCATIONS SHOWN BY DIMENSIONS ON THE FURNISH & SHOW PLAN. DIVISION ALL OUTLETS FROM THE CENTERLINE OF THE MAIN CORRIDOR AND WORK AREAS.

WHEN OUTLETS ARE GROUPED TOGETHER (FOR WORK), THEY ARE TO BE SPACED NO MORE THAN 2" APART.

ALL NEW 120V, 15, 20, AND 30 AMP RECEPTACLES OUTLETS TO BE INSTALLED AT 15" MINIMUM MEASURED TO THE BOTTOM OF THE OUTLET BOX.

ALL 480V MAXIMUM WIRING TO BE INSTALLED TO THE TOP OF THE OUTLET BOX.

SWITCHES SHALL BE INSTALLED AT 45" MINIMUM MEASURED TO THE BOTTOM OF THE OUTLET BOX AND 48" MAXIMUM MEASURED TO THE TOP OF THE OUTLET BOX.

WHERE ELECTRICAL WORK IS SPECIFIED IN CONJUNCTION WITH CABINET WORK, LAMPS AND FIXTURES ARE TO BE PROVIDED BY THE GENERAL CONTRACTOR.

4. COORDINATION WITH MILLWORK CONTRACTOR

CUT-OUTS FOR SWITCHES, OUTLETS, ETC. AS REQUIRED BY THE CABINET CONTRACTOR ARE TO BE COORDINATED WITH THE ELECTRICAL CONTRACTOR.

ALL MILLWORK CONTRACTOR SHALL BE WHITE KNAUF BUILDING STANDARD IS DIFFERENT MATCH BUILDING STANDARD CUT-OUTS FOR SWITCHES, OUTLETS AND RECEPTACLES SHALL BE WHITE KNAUF BUILDING STANDARD.

WHEN MILLWORK OCCURS SHALL BE LOCATED PER ELEVATIONS OF THE MILLWORK ITEM IN QUESTION.

5. COORDINATION WITH MILLWORK CONTRACTOR

WHEN PLYWOOD BACKSPLASHES ARE REQUIRED IN TELEPHONE AND ELECTRICAL EQUIPMENT ROOMS, THEY SHALL BE PAINTED TO MATCH ADJACENT WALL.

PROTECT ALL MILLWORK FROM ELECTRICAL WORK. REPAIR AND REFINISH ALL INCH-HOUR RATED PAINTING.

ALL EXISTING ELECTRICAL DEVICES ARE TO REMAIN UNLESS NOTED OTHERWISE.

ACCESSIBLE GROUNTS SHALL BE PERFORMED IN ACCORDANCE WITH SECTION 310-256 AND SHALL COMPLY WITH DIVISION 4 (310-256-2).
FLOOR AND OUTSIDE SURFACES SHALL BE STABLE, FIRM AND SLIP-RESISTANT AND SHALL COMPLY WITH SECTION 310-258 (310-258-2).
CHANGES IN LEVEL OF 1/4" (6.4 mm) HIGH WALKWAY SHALL BE PERMITTED TO BE VERTICAL AND WITHOUT EDGE TREATMENT. (310-258-3)
CHANGES IN LEVEL GREATER THAN 1/4" (6.4 mm) HIGH WALKWAY AND 1/2" (12.7 mm) HIGH WALKWAY SHALL BE REVEALED WITH A SLOPE NOT STEEPER THAN 1:2. (310-258-4)
CHANGES IN LEVEL GREATER THAN 1/2" (12.7 mm) HIGH SHALL BE RAISED, AND SHALL COMPLY WITH SECTION 310-435 AND 310-436 (310-435-2 AND 310-436-2).
CARPET OR CARPET TILE SHALL BE SECURELY ATTACHED AND SHALL HAVE A FIRM CUSHION, PAD OR BACKING OR NO CUSHION OR PAD. CARPET OR CARPET TILE SHALL HAVE A LEVEL, TEXTURED, LOW-PILE, CUT PILE, PILE, CUT/PAID PILE, PILE TEXTURE. PILE HEIGHT SHALL BE 1/2" (12.7 mm) OR HIGHER. CARPET OR CARPET TILE SHALL BE PERFORMED IN ACCORDANCE WITH SECTION 310-258 (310-258-2).
CARPET OR CARPET TILE SHALL COMPLY WITH SECTION 310-258 (310-258-2).

7. VERIFY THAT ALL DOORS AND DOOR HARDWARE MEET THE REQUIREMENTS OF THE TURLOCK BUILDING SAFETY ADMINISTRATIVE CODE, ALL GOVERNING CODES & STANDARDS, WITHIN THE ESCAPE IMMEDIATELY IN CASE OF DISCREPANCY
8. ALL EXIT DOORS SHALL COMPLY WITH 2003 EDITION SECTION 10.2
9. EXIT DOORS SHALL SWING IN THE DIRECTION OF EXIT TRAVEL WHEN SERVING ANY HAZARDOUS AREA OR WHEN THE AREA SERVED HAS AN OCCUPANT LOAD OF 50 OR MORE PEOPLE
10. EXIT DOORS SHALL BE OPENED FROM THE INSIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT. PROVIDE A SIGN ON OR NEAR THE MAIN EXIT DOOR READING: "THIS DOOR TO REMAIN UNLOCKED WHEN THIS SPACE IS OCCUPIED."
11. LATCHING AND LOCKING DEVICES SHALL BE HAND OPERATED AND SHALL BE MANEUVERABLE WITH A SINGLE FINGER WITHOUT REQUIRING THE ABILITY TO GRASP THE HARDWARE (LEVER OR PUSH TYPE). VERIFY CONFORMANCE AT EXISTING DOORS.
12. MAXIMUM UNWEIGHTED DOOR SHALL NOT EXCEED THE FOLLOWING PER THE REQUIREMENTS OF CALIFORNIA BUILDING CODE:
 - a. INTERIOR DOORS - 5 POUNDS
 - b. EXTERIOR DOORS - 5 POUNDS
 - c. FIRE DOORS - 15 POUNDS
13. DOOR CLOSERS AND EXIT CLOSERS SHALL BE ADJUSTED SO THAT AN OPEN POSITION OF 30 DEGREES, THE TIME REQUIRED TO MOVE THE DOOR TO THE CLOSURE POSITION SHALL BE WITHIN 15 TO 30 SECONDS MINIMUM. (CIB 118-434.2.2.1)
14. RATED DOORS SHALL COMPLY WITH EBC SECTION 7.0.2.1
15. ALL DOOR HARDWARE TO BE LEVER-TYPE PER STATE AND ADA CODES
16. TO ENSURE HAZARDOUS AREAS ARE TO BE EVACUATED THROUGH THE DOOR FROM FLOOR, CONSTRUCTION TO VERIFY EXISTING CONDITIONS AND MATCH AND
17. SPECIAL LOCKING DEVICES SHALL BE OF AN APPROVED TYPE
18. THE BUILDING SHALL HAVE AUTOMATICALLY SMOKEING DOORS HAVE A SMOOTH UNWEIGHTED SURFACE
19. MAXIMUM UNWEIGHT OF ALL DOORS NOT IN A RATED CORRIDOR SHALL NOT EXCEED 1"2" ABOVE FINISH FLOOR SURFACE
20. THE FLOOR AND LATCHING SHALL BE NOT MORE THAN 1"2" LOWER THAN THE TOP OF THE THRESHOLD OF THE DOORWAY. LEVEL (2: MAX SLOPE)
21. PROVIDE WEATHER SLASH AT ALL EXTERIOR DOORS PER AND STANDARDS
22. ALL GLAZING WITH A 24" RADIUS OF EITHER EDGE OF A DOOR AND WITHIN 60" OF THE FLOOR SHALL BE TEMPLERED
23. COORDINATE REPAIRS TO ALL DOOR FRAMES WITH "HARD" REPAIRS TO EACH LOCKING
24. ALL INTERIOR DOOR FRAMES TO BE FACTORY FINISH
25. EXTERIOR LEVEL SHALL BE NOT MORE THAN 1"2" ABOVE FINISH FLOOR PER FOOT IN ANY DIRECTION FOR SURFACE DRAINAGE
26. ALL DOOR STOPS TO HAVE 2"X6 DRAINAGE IN WALL BEHIND

1. BUILDINGS UNDER CONSTRUCTION OR DEMOLITION SHALL CONFORM TO CITY CHAPTER 333 ON SMOKEPROOF COOKING GAS APPLIANCES IN STRUCTURES WHERE COMBUSTIBLE MATERIALS ARE EXPOSED OR WITHIN 20' OF COMBUSTIBLE MATERIALS STORAGE AREAS, COULING, WELDING, OR OTHER HOT WORK ACTIVITIES. CITY OF CHICAGO ORDINANCE 12-0001.

2. ADDRESS NUMBERS SHALL BE PROVIDED FOR ALL NEW AND EXISTING BUILDINGS. A MAXIMUM OF FOUR DIGITS MUST FOR INDIVIDUAL DWELLING UNITS. ADDRESS NUMBERS SHALL BE PROVIDED FOR ALL MULTIFAMILY BUILDINGS. ADDRESS NUMBERS SHALL BE PROVIDED FOR ALL COMMERCIAL BUILDINGS. ADDRESS NUMBERS SHALL BE PROVIDED FOR ALL INDUSTRIAL BUILDINGS. ADDRESS NUMBERS SHALL BE PROVIDED FOR ALL TEMPORARY ADDRESS NUMBERS SHALL BE PROVIDED ON CONSTRUCTION AT LEAST ON THE BUILDING UNIT.

3. LOCATIONS AND CLASSIFICATIONS OF EXTINGUISHERS SHALL BE IN ACCORDANCE WITH CITY CODE AND IBC TABLE 906. AT LEAST ONE EXTINGUISHER SHALL BE PROVIDED DURING CONSTRUCTION ON EACH FLOOR AT EACH STATIONARY IN FLOOR STORAGE AND CONSTRUCTION SITES. IN LOCATIONS WHERE THERE ARE COMBUSTIBLE LIQUIDS, SOLIDS OR STORED OR WHEN THERE ARE HAZARDOUS MATERIALS PRESENT PER CITY 333.111, ONE ADDITIONAL EXTINGUISHER SHALL BE PROVIDED ON EACH FLOOR. EXTINGUISHERS SHALL BE PROVIDED SO THAT NO EXTINGUISHER IS MORE THAN 75 FEET FROM THE EXTINGUISHER. EXTINGUISHERS SHALL BE PROVIDED AT LEAST ABOVE THE FLOOR. ADDITIONAL EXTINGUISHERS MAY BE REQUIRED BY INSPECTOR DETERMINING PROPER SITE.

4. WALL, FLOOR AND CEILING FINISHES AND MATERIALS SHALL NOT EXCEED THE FLAME SPREAD CLASSIFICATION IN IBC TABLE 803.1.5. COGNITIVE FINISHES SHALL BE PROVIDED ON ALL EXTERIOR WALLS AND FLOORS. EXTERIOR WALLS SHALL BE PROVIDED ON ALL EXTERIOR WALLS AND FLOORS.

5. APPROVAL OF THESE STANDARDS SHALL NOT PERMIT THE VIOLATION OF ANY CODE OR LAW REQUIREMENTS OR FEATURES NOT IDENTIFIED ON THE PLAN. APPROVAL OF THESE STANDARDS SHALL NOT PERMIT THE VIOLATION OF ANY CODE OR LAW REQUIREMENTS OR FEATURES NOT IDENTIFIED ON THE PLAN. APPROVAL OF THESE STANDARDS SHALL NOT PERMIT THE VIOLATION OF ANY CODE OR LAW REQUIREMENTS OR FEATURES NOT IDENTIFIED ON THE PLAN.

6. APPROVED FIELD CONDITIONS WHICH CHANGE MAY NECESSITATE SUBMITTAL OF REVISED OR AS-BUILT PLANS TO THE FIRE DEPARTMENT.

[illegible]

14. A FIRE ALARM SYSTEM SHALL BE PROVIDED IN COMPLIANCE WITH CBC/CFC 907 AND 2022 NPA 72. A SEPARATE PLAN SUBMITTAL IS REQUIRED FOR APPROVAL PRIOR TO INSTALLATION OR MODIFICATION.

15. AUTOMATIC FIRE SPRINKLER SYSTEM(S) AND ALL CONTROL VALVES, WITH THE EXCEPTION OF THOSE LISTED IN CFC 903.4, SHALL BE MONITORED BY A LISTED CENTRAL ALARM STATION.

10. STORAGE, DISPENSING, OR USE OF ANY HAZARDOUS MATERIALS SHALL COMPLY WITH CDC 414 AND 415 AND CFC REGULATIONS. THE STORAGE AND USE OF HAZARDOUS MATERIALS SHALL BE REVIEWED AND APPROVED BY THE FIRE DEPARTMENT PRIOR TO SUCH MATERIALS BEING BROUGHT ON SITE. APPROPRIATE HAZARDOUS MATERIALS WARNING SIGNS SHALL BE PROMINENTLY PLACED IN THE VICINITY/ENTRANCES TO AREAS WHERE HAZARDOUS MATERIALS ARE STORED OR USED.

11. HAZARDOUS PROCESSES AND EQUIPMENT (E.G., STORAGE TANKS, REFRIGERATION, VAPOR RECOVERY, SPRAY BOOTHS AND DRYING ROOMS; DUST TANKS, INDUSTRIAL OVENS, DUST COLLECTION SYSTEMS, MEDICAL/INDUSTRIAL GAS SYSTEMS, ETC.) SHALL BE REVIEWED AND APPROVED BY THE FIRE DEPARTMENT PRIOR TO INSTALLATION. SUCH EQUIPMENT AND PROCESSES MAY REQUIRE SPECIAL BUILDING FEATURES AND PROTECTION BEYOND WHAT IS REQUIRED BY THE IBC.

ABRIPT CHANGES IN LEVELS EXCEED 4 INCHES (102 mm) IN A VERTICAL DIRECTION BETWEEN SIDEWALKS OR OTHER PEDESTRIAN WAYS AND ADJACENT SURFACES OR FEATURES SHALL BE IDENTIFIED BY WARNING CURBS AT LEAST 6 INCHES (152 mm) IN HEIGHT ABOVE THE WALK OR SIDEWALK SURFACE (110-300.5)

PROTRUDING OBJECTS SHALL COMPLY WITH SECTION 110-301. (110-301.1)

OBJECTS WITH LEADING EDGES MORE THAN 27 INCHES (686 mm) AND NOT MORE THAN 80 INCHES (2032 mm) ABOVE THE FINISH FLOOR OR SIDEWALK SHALL PROTRUDE 4 INCHES (102 mm) MAXIMUM HORIZONTALLY INTO THE CIRCULATION PLANE. (110-302.2)

FREE-STANDING OBJECTS MOUNTED ON POSTS OR PLACED SLIGHTLY OVERHANGING CIRCULATION PLATE 12 INCHES (303 mm) MAXIMUM WHEN LOCATED 27 INCHES (686 mm) AND 80 INCHES (2032 mm) MAXIMUM ABOVE THE FINISH FLOOR OR SIDEWALK. WHERE A SIGN OR OTHER OBSTRUCTION IS MOUNTED BETWEEN POSTS OR PLINGS OR THE CLEAR DISTANCE BETWEEN THE POSTS OF PLINGS IS GREATER THAN 12 INCHES (303 mm), THE LOWEST EDGE OF SIGN OR POST OR OBSTRUCTION SHALL BE 27 INCHES (686 mm) MAXIMUM OR 80 INCHES (2032 mm) MINIMUM ABOVE THE FINISH FLOOR OR SIDEWALK. (110-302.3)

VERTICAL CLEARANCE SHALL BE 80 INCHES (2032 mm) HIGH MINIMUM. GUARDRAILS OR OTHER BARRIERS SHALL BE PROVIDED WHERE THE VERTICAL CLEARANCE IS LESS THAN 80 INCHES (2032 mm) HIGH. THE LEADING EDGE OF SUCH GUARDRAIL BARRIER SHALL BE LOCATED 27 INCHES (686 mm) ABOVE THE FINISH FLOOR OR SIDEWALK SURFACE. GUARDRAILS SHALL BE 4 INCHES (102 mm) MAXIMUM WIDE AND NOT LIMITED TO SIDEWALKS. AT CURB, SIDEWALK CURB OR SIMILAR DEVICE SHOULD BE USED TO PREVENT AN OVERHANGING OBSTRUCTION. (110-303)

[illegible][illegible]

DRAWING NOTES:

- 1. UNLESS OTHERWISE NOTED OR INDICATED, ALL DIMENSIONS ON THESE DOCUMENTS SHALL BE FROM FINISHED FACE TO FINISHED FACE OF WALL.
- 2. ALL VERTICAL DIMENSIONS SHOWN ARE FROM FLOOR SLAB, UNLESS OTHERWISE NOTED.
- 3. DIMENSIONS SHOWN IN PARENTS TAKE PRECEDENCE OVER DIMENSIONS SCALED FROM DRAWINGS. LARGE SCALE DRAWINGS AND DETAILS TAKE PRECEDENCE OVER SMALL SCALE DRAWINGS.
- 4. THE TERM "ALIGN," AS USED IN THESE DOCUMENTS, SHALL MEAN TO ACCURATELY LOCATE FINISHES IN THE SAME PLANE.
- 5. "TYPICAL" AS USED IN THESE DOCUMENTS SHALL MEAN THAT THE CONDITION IS THE SAME OR REPRESENTATIVE FOR ALL SIMILAR CONDITIONS THROUGHOUT, UNLESS NOTED OTHERWISE.
- 6. DETAILS ARE USUALLY KEPT AND NOTED "TYPICAL ONLY" ONCE, WHEN THEY FIRST OCCUR AND ARE REPRESENTATIVE OF ALL SIMILAR CONDITIONS THROUGHOUT.

VENTILATION NOTES:

1. NATURAL VENTILATION OF AN OCCUPIED SPACE SHALL BE THROUGH WINDOWS, DOORS, LOUVERS OR OTHER OPENINGS TO THE OUTDOORS. THE OPERATING MECHANISM FOR SUCH OPENINGS SHALL BE PROVIDED WITH READY ACCESS SO THAT THE OPENINGS ARE READILY CONTROLLABLE BY THE BUILDING OCCUPANTS. (CBC 1202.5)

2. VENTILATION AND EXHAUST SYSTEMS FOR OCCUPANCIES AND OPERATIONS INVOLVING FLAMMABLE OR COMBUSTIBLE HAZARDS OR OTHER CONTAMINANT SOURCES SHALL BE DESIGNED TO PREVENT THE RELEASE OF SUCH CONTAMINANTS INTO THE OCCUPYED SPACE. (CBC 1202.5)

1. ENVELOPE COMPLIANCE AND STATEMENT OF DESIGN COMPLIANCE: THE CALIFORNIA ENERGY CONSERVATION STANDARDS FOR NON-RESIDENTIAL BUILDING SHALL BE REVIEWED AND COMPLIED WITH DURING THE CONSTRUCTION AND TENANT IMPROVEMENT WORK SCOPE OF THIS PROJECT.

Project For: EMPEROR AUTO BODY 2851 LASTER LANE TURLOCK, CA 95380		Prepared For: HYDRODESIGN, INC. 10202 EAST ST GARDEN GROVE, CA 92640 CONTACT: RANDY OMOZCO TEL: (714) 964-6470 EMAIL: randy@hydrodesign.com		STAMP APPROVED FOR THE PROJECT DATE: 5/24/23 SHEET TITLE: GENERAL NOTES		DATE: 04/28/23 SCALE: AS NOTED DRAWN: P. BROZGLO JOBS: - SHEET NO: GN1	
PLEASE PRINTING & REPRODUCTION OF THIS DOCUMENT IS PROHIBITED WITHOUT THE WRITTEN PERMISSION OF THE AUTHOR. ANY REPRODUCTION OF THIS DOCUMENT WITHOUT THE WRITTEN PERMISSION OF THE AUTHOR IS PROHIBITED.		DESCRIPTION WHSR DISCREETARY PERMIT		DATE 05/24/23		BY PHD	
DESCRIPTION		DATE		BY		DATE	

STAMP

LICENSED PROFESSIONAL ENGINEER

JAMES G. FOL
EITING
Feb. 2002/2003
Civil Engineer

STATE OF CALIFORNIA

SHEET TITLE:	5/24/23

GENERAL NOTES

10

DATE: 04/25/23
SCALE: 45 MOED

DRAWN: R. OROZCO

SHEET NO.	JOB: -

GN1

□


DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN CODE). DUE TO THE VARIATION BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE FULL CODE.

2022 CALIFORNIA GREEN BUILDING STANDARDS CODE
NONRESIDENTIAL MANDATORY MEASURES, SHEET 3 (January 2023)

TABLE 5.504.4 FRESH MATERIAL POLLUTANT CONTROL	FINISH MATERIALS shall comply with Sections 5.504.4.1 through 5.504.4.2.	REMARKS	SECTION 5.504.4.1 - ADHESIVE VOC LIMIT
5.504.4.1 Adhesives, sealants and caulks, Adhesive, sealant, and caulk used on the project shall meet the requirements of the following standards:			
1. All adhesive primers, adhesive primers and caulks used on the project shall comply with local or national control or air quality management district rules where applicable, or SCQM/VOL 118C VOC limits as shown in Tables 5.504.4.1 and 5.504.4.2. Such caulk also shall comply with the Title 150 prohibition on the use of certain toxic compounds (chromium, ethylene dibromide, methylene chloride, perchloroethylene and trichloroethylene), except for aerosol products as specified in Section 5.504.4.2 below.			
2. Aerosol adhesives, and smaller unit sizes of adhesive, and sealant or caulking compounds (in units of product, less packaging, which do not weigh more than one pound and are not a coat of more than 1/32 inch) shall comply with California VOC standards and other requirements, including prohibitions on use of certain toxic compounds, of California Code Regulations, Title 17, commencing with Section 86027.			
TABLE 5.504.4.1 - ADHESIVE VOC LIMIT			
Less Water and Less Exempt Compounds in Grams per Liter			
ARCHITECTURAL APPLICATIONS	CURRENT VOC LIMIT		
INDOOR CARPET ADHESIVES	50		
CARPET PAD ADHESIVES	50		
OUTDOOR CARPET ADHESIVES	150		
WOOD FLOORING ADHESIVES	100		
RUBBER FLOOR ADHESIVES	60		
SUBFLOOR ADHESIVES	50		
CERAMIC TILE ADHESIVES	50		
VCT & ASPHALT TILE ADHESIVES	50		
DRYWALL & PANEL ADHESIVES	50		
CONCRETE BASE ADHESIVES	50		
MULTIPURPOSE CONSTRUCTION ADHESIVES	70		
STRUCTURAL GLAZING ADHESIVES	100		
SINGLE-PLY ROOF MEMBRANE ADHESIVES	250		
OTHER ADHESIVE NOT SPECIFICALLY LISTED	50		
SPECIALTY APPLICATIONS			
PVC WELDING	510		
CPVC WELDING	400		
ABS WELDING	350		
PLASTIC CEMENT WELDING	250		
ADHESIVE PRIMER FOR PLASTIC	550		
CONTACT ADHESIVE	80		
SPECIAL PURPOSE CONTACT ADHESIVE	250		
STRUCTURAL WOOD MEMBER ADHESIVE	140		
TIE & TRIM ADHESIVE	250		
SUBSTRATE SPECIFIC APPLICATIONS			
METAL TO METAL	50		
PLASTIC TO METAL	50		
POROUS MATERIAL (EXCEPT WOOD)	50		
WOOD	30		
FIBERGLASS	80		
1. IF AN ADHESIVE IS USED TO BOND DISSIMILAR SUBSTRATES TOGETHER, THE ADHESIVE WITH THE HIGHEST VOC CONTENT SHALL BE ALLOWED.			
2. FOR ADDITIONAL INFORMATION REGARDING METHODS TO MEASURE THE VOC CONTENT SPECIFIED IN THIS TABLE, SEE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 118L, www.scaqmd.org/documents/certificationrule118l.pdf			
TABLE 5.504.4.2 - SEALANT VOC LIMIT			
Less Water and Less Exempt Compounds in Grams per Liter			
SEALANTS	CURRENT VOC LIMIT		
ARCHITECTURAL	250		
MARINE DECK	700		
NONMEMBRANE ROOF	300		
SHEDDING	450		
SINGLE-PLY ROOF MEMBRANE	400		
OTHER	400		
SPECIAL PRIMERS			
ARCHITECTURAL			
NONPOROUS	250		
POROUS	775		
MODIFIED BITUMINOUS	500		
MARINE DECK	750		
NOTE: FOR ADDITIONAL INFORMATION REGARDING METHODS TO MEASURE THE VOC CONTENT SPECIFIED IN THESE TABLES, SEE SOUTH COAST AIR QUALITY MANAGEMENT DISTRICT RULE 118L			
5.504.4.3 Primer and caulks, Architectural primer and caulks shall comply with VOC limits in Table 17 of the Air Resources Control District Suggested Control Measures, as shown in Table 5.504.4.3, unless more stringent provisions apply. The VOC content for coatings that do not meet the definitions for the specialty finishes categories listed in Table 5.504.4.3 shall be determined by classifying the coating as a flat, hardcoat or non-flat/high-gloss coating, based on gloss, as defined in Subsections 4.21, 4.32 and 4.37 of the 2007 edition of the American National Standards Institute's (ANSI) Z39.9-2007 Gloss Rating System, located at North-Haven High-Gloss Vocab in Table 5.504.4.3.4 below.			
5.504.4.3.1 Aerialized Primers and caulks, Aerialized primers and caulks shall meet the PMVOC Limit for RSC in Section 86029(a)(1) and other requirements, including prohibitions on use of certain toxic compounds and epoxide dehydrating solvents, in Sections 86029(c)(1) and (d)(2) of California Code Regulations, Title 17, commencing with Section 86027, and in areas under the jurisdiction of the Bay Area Air Quality Management District additionally comply with the percent VOC by weight of product limits of Regulation 9.4(d).			
TABLE 5.504.4.3 - FORMALDEHYDE EMISSIONS LIMITS			
PRODUCT	CURRENT LIMIT		
HARDWOOD PLYWOOD VENEER CORE	0.05		
HARDWOOD PLYWOOD COMPOSITE CORE	0.05		
PARTICLE BOARD	0.09		
MEDIUM DENSITY FIBERBOARD	0.11		
THIN MEDIUM DENSITY FIBERBOARD	0.13		
1. VALUES WITHIN THESE TABLES ARE THOSE SPECIFIED BY THE CALIFORNIA AIR RESOURCES BOARD AIR TOXICS CONTROL MEASURES FOR COMPOSITE WOOD AS TESTED IN ACCORDANCE WITH ASTM 11303, FOR FORMALIN, AND/OR OTHER COMPOUNDS THAT EXCEED THE PMVOC LIMIT OF SECTION 86029(b)(1) AND (2).			
2. THIN MEDIUM DENSITY FIBERBOARD HAS A MAXIMUM THICKNESS OF SIX EIGHTHS INCH.			
TABLE 5.504.4.3 - CONT.			
GRAMS OF VOC PER LITER OF COATING, LESS WATER & LESS EXEMPT COMPOUNDS			
COATING CATEGORY	CURRENT VOC LIMIT		
SPECIALTY COATINGS			
ALUMINUM ROOF COATINGS	400		
BACKEMENT SPECIALTY COATINGS	400		
BITUMINOUS ROOF COATINGS	50		
BITUMINOUS ROOF PRIMERS	350		
BOND BREAKERS	350		
CONCRETE CURING COMPOUNDS	350		
CONCRETE/MASONRY SEALERS	100		
DRYDAVE SEALERS	50		
DYE FINISH COATINGS	150		
FAUX FINISH COATINGS	350		
FLUOR RESISTIVE COATINGS	350		
FLOOR COATINGS	350		
FORMALDEHYDE COMPOUNDS	50		
GRAPHIC ARTS COATINGS (SIGN PAINTS)	50		
HIGH-TEMPERATURE COATINGS	420		
INDUSTRIAL MAINTENANCE COATINGS	250		
LOW SOLIDS COATINGS	120		
MARGNERITE CEMENT COATINGS	450		
MASTIC COATINGS	100		
METALLIC POWDERED COATINGS	50		
MULTICOAT COATINGS	250		
PRETREATMENT WASH PRIMERS	420		
PRIMERS, SEALERS & UNDERCOATS	100		
REACTIVE PENETRATING SEALERS	350		
RECYCLED COATINGS	250		
ROOF COATINGS	50		
ROOF PREVENTATIVE COATINGS	250		
SHIELDS	350		
CLEAR	730		
OPAQUE	650		
SPECIALTY PRIMERS, SEALERS & UNDERCOATS	100		
STAINS	250		
STONE CONSOLIDANTS	400		
SWIMMING POOL COATINGS	340		
TRAFFIC MARKING COATINGS	100		
TIE & TRIM REFRESH COATINGS	250		
WATERPROOFING MEMBRANES	250		
WOOD COATINGS	275		
WOOD PRESERVATIVES	350		
ZINC-ORGANIC COATINGS	340		
1. GRAMS OF VOC PER LITER OF COATING, INCLUDING WATER & EXEMPT COMPOUNDS			
2. THIS SPECIFIED LIMITS ARE IN EFFECT UNLESS LOWER LIMITS ARE LISTED IN SUBSECTION COLUMNS IN SECTION 5.504.4.3.4			
3. VALUES IN THIS TABLE ARE DERIVED FROM THOSE SPECIFIED BY THE CALIFORNIA AIR RESOURCES BOARD, ARCHITECTURAL COATING SOURCE CONTROL MEASURES, FINAL, 11/8/06, MORE INFORMATION IS AVAILABLE FROM THE AIR RESOURCES BOARD.			
5.504.4.3.2 Verification, Verification of compliance with this section shall be provided at the request of the enforcing agency. Documentation may include, but is not limited to, the following:			
1. Manufacturer's product specification			
2. Field verification of in-situ product containers			
5.504.4.4 Carpet Systems, All carpet installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.1 Carpet caulks, All carpet caulks installed in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.2 Carpet adhesive, All carpet adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.3 Carpet underlayment, All carpet underlayment used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.4 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.5 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.6 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.7 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.8 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.9 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.10 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.11 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.12 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.13 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.14 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.15 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.16 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.17 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.18 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.19 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.20 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.21 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.22 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.23 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.24 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.25 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.26 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.27 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.28 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.29 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.30 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.31 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.32 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.33 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.34 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.35 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.36 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.37 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.38 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.39 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.40 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.41 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.42 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.43 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.44 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.45 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.46 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.47 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.48 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.49 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.50 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.51 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.52 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.53 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.54 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.55 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.56 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.57 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.58 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.59 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.60 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.61 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.62 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.63 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.64 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.65 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.66 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and Evaluation of Volatile Organic Chemical Emissions from Indoor Sources Using Environmental Chambers," Version 1.2, January 2017 (Emission testing method for California Specifications 01350).			
5.504.4.4.67 Carpet underlayment adhesive, All carpet underlayment adhesive used in the building interior shall meet the requirements of the California Department of Public Health, "Standard Method for the Testing and			

DISCLAIMER: THIS DOCUMENT IS PROVIDED AND INTENDED TO BE USED AS A MEANS TO INDICATE AREAS OF COMPLIANCE WITH THE CALIFORNIA GREEN BUILDING STANDARDS (CALGREEN CODE). DUE TO THE VARIABLES BETWEEN BUILDING DEPARTMENT JURISDICTIONS, THIS CHECKLIST IS TO BE USED ON AN INDIVIDUAL PROJECT BASIS AND MAY BE MODIFIED BY THE END USER TO MEET THOSE INDIVIDUAL NEEDS. THE END USER ASSUMES ALL RESPONSIBILITY ASSOCIATED WITH THE USE OF THIS DOCUMENT, INCLUDING VERIFICATION WITH THE BUILDING DEPARTMENT.

LEW LANE

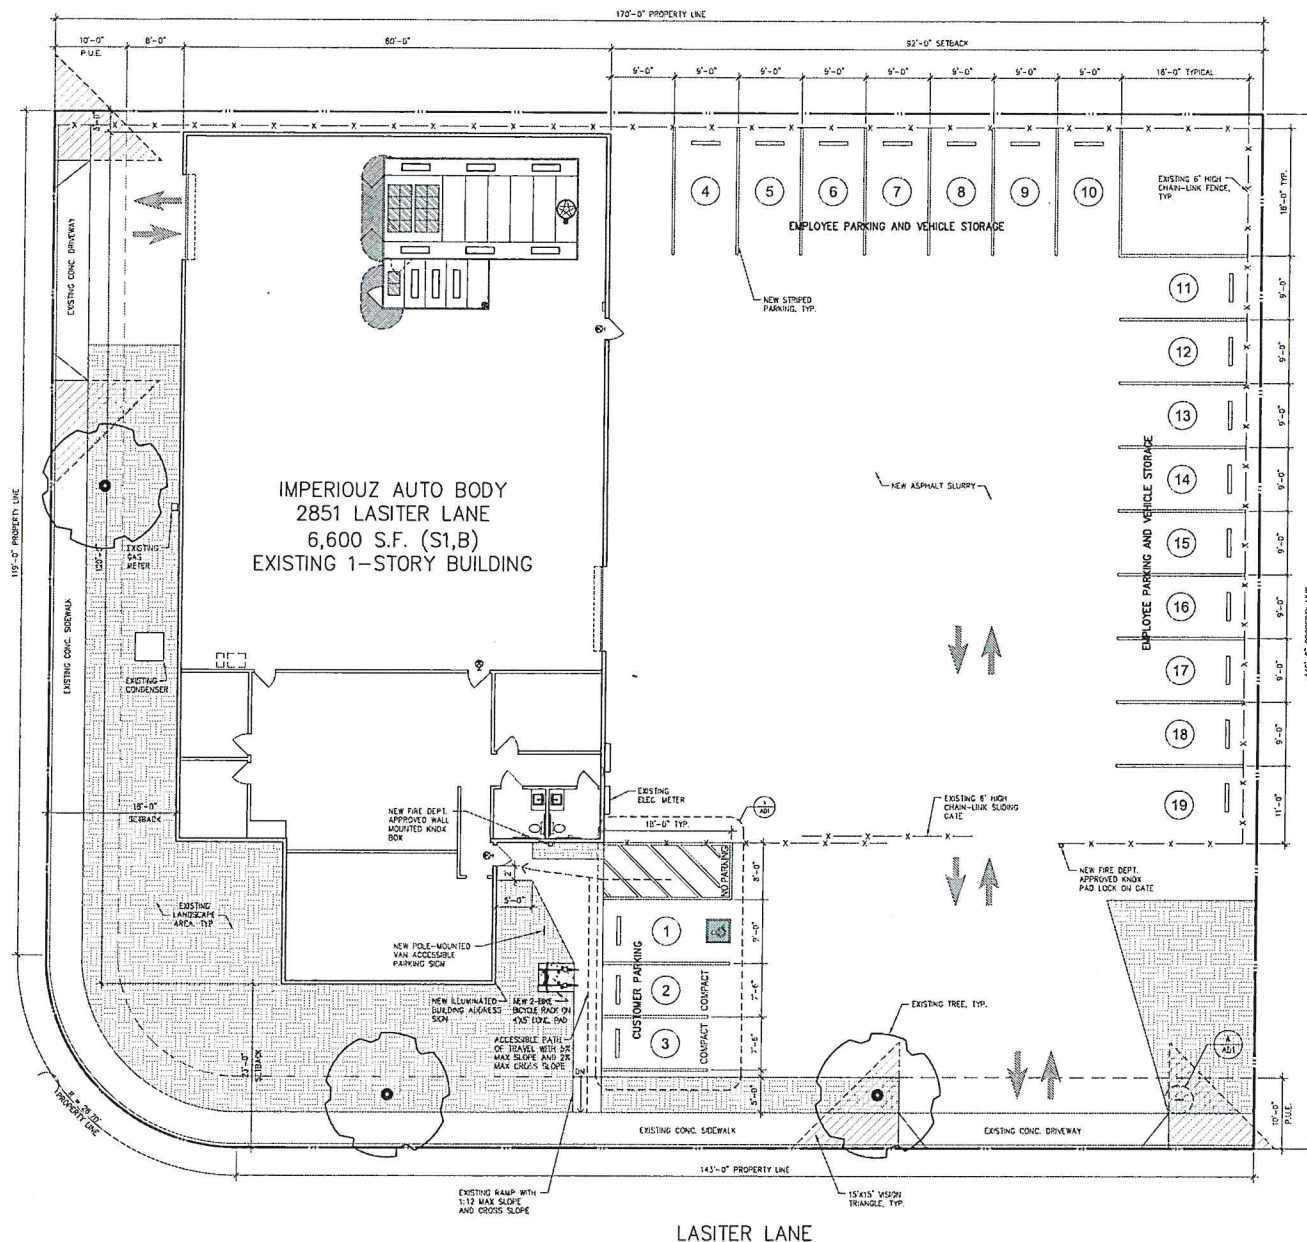

PROPOSED SITE PLAN
SCALE: 1/8" = 1'-0"

SITE LEGEND:

- VEHICULAR CIRCULATION PATH
- # NUMBER OF PARKING STALLS
- (X) CHAIN-LINK PERIMETER FENCE/SLIDING GATE
- (X) PROPERTY LINE


PARKING SUMMARY:

REQUIRED PARKING:
 1 SPACE PER 1,000 SQUARE FEET OF GROSS FLOOR AREA
 1 BICYCLE SPACE PER 100 OF AUTOMOBILE SPACES
 A MAXIMUM OF 50% OF TOTAL PARKING MAY BE COMPACT
 6,600 SQUARE FEET / 1,000 SQUARE FEET = 7 SPACES REQUIRED
 18 SPACES X 10% = 2 BICYCLE SPACE REQUIRED

PARKING PROVIDED:
 STANDARD SPACES: 16 SPACES
 COMPACT SPACES: 3 SPACES
 ACCESSIBLE SPACES: 1 VAN SPACE
 TOTAL: 19 SPACES

BICYCLE SPACES: 1 (2) BIKE BICYCLE RACK

THESE DRAWINGS & SPECIFICATIONS ARE THE PROPERTY & COPYRIGHT OF RND DESIGNS. NO PART OF THIS DOCUMENT SHALL BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT PERMISSION IN WRITING FROM RND DESIGNS.	
Prepared By: RND DESIGNS, INC. 1162 WEST ST. GARDEN GROVE, CA 92640 CONTACT: RANDY ORDOZCO TEL: 714.944.1111 EMAIL: rando@rnddesigns.com	Project For: IMPERIOUZ AUTO BODY 2851 LASITER LANE TULOCK, CA 95160
DATE: 04/28/23 SCALE: AS NOTED DRAWN: P. ORDOZCO JOB: - SHEET NO.	STAMP RND DESIGNS 5/24/23 SHEET TITLE: PROPOSED SITE PLAN
A2	

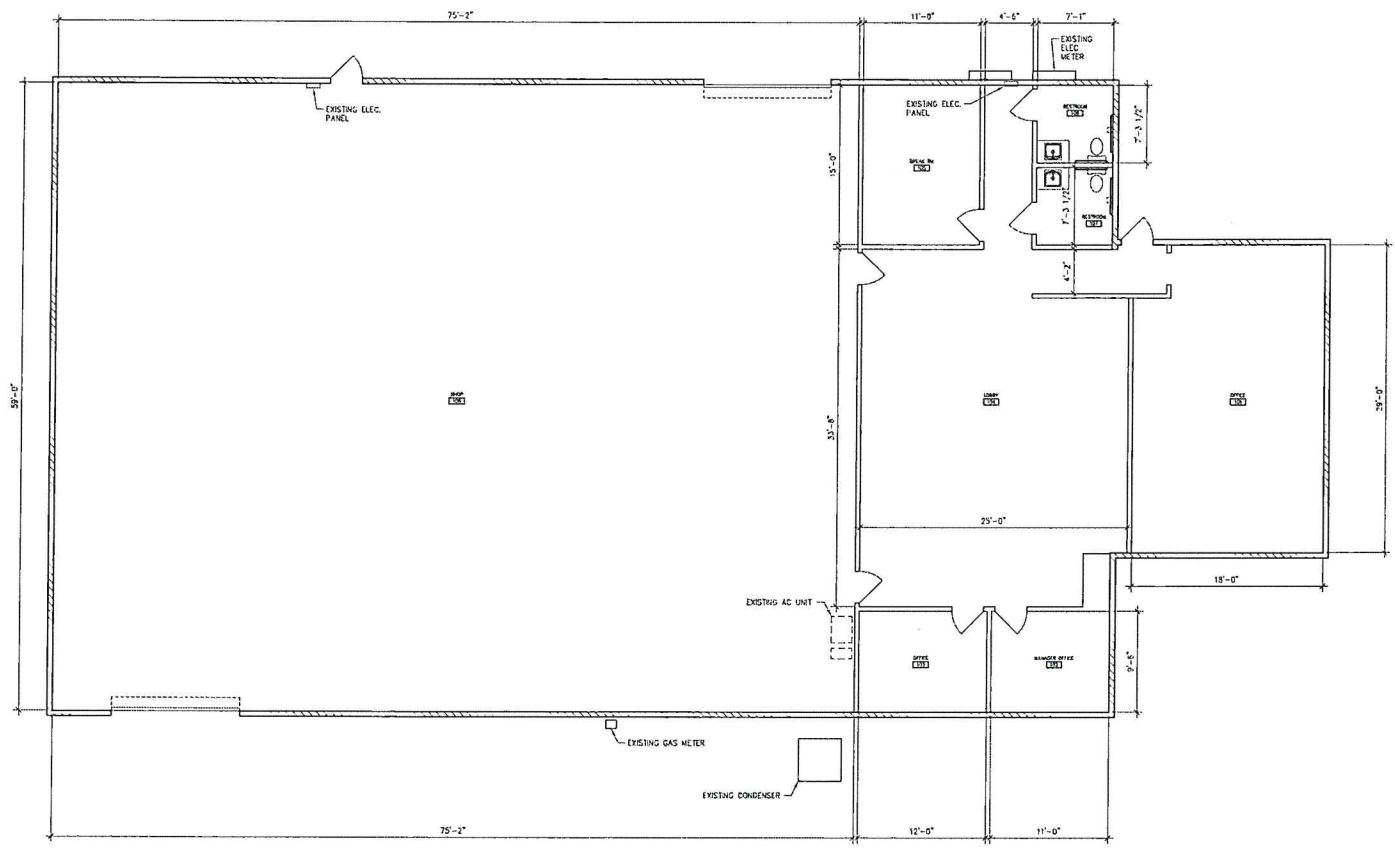


EXISTING FLOOR PLAN
SCALE: 3/16" = 1'-0"

1

Prepared By: RND DESIGNS, INC. 1162 WEST ST. GARDEN GROVE, CA 92640 CONTACT: RANDY ORDOZCO EMAIL: rando@rnddesigns.com		Project For: IMPERIAL AUTO BODY 2511 LASTER LANE TURLOCK, CA 95380	
Description: WOOD DESIGN/REPAIR PERMIT	Date: 05/24/23	By: RPD	Date: 05/24/23
Stamp: RND DESIGNS, INC. 1162 WEST ST. GARDEN GROVE, CA 92640 5/24/23		SHEET TITLE: EXISTING FLOOR PLAN	
DATE: 04/28/23 SCALE: AS NOTED DRAWN: P. ORDOZCO		JOB: - SHEET NO.: A3	

THIS DRAWING & SPECIFICATIONS ARE THE PROPERTY & COPYRIGHT OF RND DESIGNS & SHALL NOT BE USED ON ANY OTHER WORK WITHOUT WRITTEN PERMISSION FROM RND DESIGNS. ANY VIOLATION SHALL BE PROSECUTED TO THE FULL EXTENT OF THE LAW. NO PART OF THIS DRAWING SHALL BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, WITHOUT PERMISSION FROM RND DESIGNS.



1	2	3	4	5	6	7	8	9	10	11	12	13	14	15	16	17	18	19	20	21	22	23	24	25	26	27	28	29	30	31	32	33	34	35	36	37	38	39	40	41	42	43	44	45	46	47	48	49	50	51	52	53	54	55	56	57	58	59	60	61	62	63	64	65	66	67	68	69	70	71	72	73	74	75	76	77	78	79	80	81	82	83	84	85	86	87	88	89	90	91	92	93	94	95	96	97	98	99	100
---	---	---	---	---	---	---	---	---	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	----	-----

TABLE 1006.3.2
MINIMUM NUMBER OF EXITS OR
ACCESS TO EXITS PER STORY

OCCUPANT LOAD PER STORY	MINIMUM NUMBER OF EXITS OR ACCESS TO EXITS FROM STORY
1-500	2
501-1,000	3
MORE THAN 1,000	4

TABLE 1017.2
EXIT ACCESS TRAVEL DISTANCE


OCCUPANCY	WITHOUT SPRINKLER SYSTEM (FEET)	WITH SPRINKLER SYSTEM (FEET)
A, E, F-1, M, R, S-1-1	200	250
B	250	300

SYMBOLS LEGEND:

- INDICATES FULLY ACCESSIBLE EXIT
- NEW OR EXISTING WALL-MOUNTED EXIT SIGN W/ BATTERY BACKUP, SHADED GLOWMANT INDICATES FACE OF LETTERING
 - NEW OR EXISTING CEILING-MOUNTED EXIT SIGN W/ BATTERY BACKUP, SHADED GLOWMANT INDICATES FACE OF LETTERING
- NOTE: EXIT SIGNS SHALL BE SELF-LUMINOUS TYPE OR ELECTRICALLY ILLUMINATED & ENERGIZED FROM SEPARATE CIRCUITS, ONE OF WHICH SHALL BE FROM STORAGE BATTERIES OR AN ON-SITE GENERATOR
- NOTE: ADDITIONAL DIRECTIONAL EXIT SIGNS MAY BE REQUIRED PRIOR TO FINAL INSPECTION AND SUBJECT TO BUILDING INSPECTOR

EGRESS NOTES:

- EXIT SIGNS SHALL BE INTERNALLY OR EXTERNALLY ILLUMINATED (1013.3)
- ELECTRICALLY POWERED, SELF-LUMINOUS AND PHOTO-LUMINOUS EXIT SIGNS SHALL BE LISTED AND LABELED IN ACCORDANCE WITH UL 924 AND SHALL BE INSTALLED IN ACCORDANCE WITH THE MANUFACTURER'S INSTRUCTIONS AND CHAPTER 27. EXIT SIGNS SHALL BE ILLUMINATED AT ALL TIMES (1013.5)
- EXTERNALLY ILLUMINATED EXIT SIGNS SHALL COMPLY WITH SECTIONS 1013.6.1 THROUGH 1013.6.3 (1013.6)
- EXIT SIGNS SHALL BE ILLUMINATED AT ALL TIMES, TO ENSURE CONTINUED ILLUMINATION FOR A DURATION OF NOT LESS THAN 90 MINUTES IN CASE OF PRIMARY POWER LOSS. THE SIGN ILLUMINATION MEANS SHALL BE CONNECTED TO AN EMERGENCY POWER SYSTEM PROVIDED FROM STORAGE BATTERIES, UNIT EQUIPMENT OR AN ON-SITE GENERATOR. THE INSTALLATION OF THE EMERGENCY POWER SYSTEM SHALL BE IN ACCORDANCE WITH CHAPTER 27, GROUP 1-2, CONDITION 2. EXIT SIGN ILLUMINATION SHALL NOT BE PROVIDED BY UNIT EQUIPMENT BATTERIES ONLY (1013.6.3)
- DOORS IN THE MEANS OF EGRESS SHALL COMPLY WITH THE REQUIREMENTS OF SECTIONS 1010.1.1 THROUGH 1010.1.4. EXTERIOR DOORS SHALL ALSO COMPLY WITH THE REQUIREMENTS OF SECTION 1022.2. GATES IN THE MEANS OF EGRESS SHALL COMPLY WITH THE REQUIREMENTS OF SECTION 1010.4 AND 1010.4.1 (1010.1)
- EGRESS DOORS SHALL BE READILY DISTINGUISHABLE FROM THE ADJACENT CONSTRUCTION AND FINISHES SUCH THAT THE DOORS ARE EASILY RECOGNIZABLE AS DOORS. MIRRORS OR SIMILAR REFLECTING MATERIALS SHALL NOT BE USED ON MEANS OF EGRESS DOORS. MEANS OF EGRESS DOORS SHALL NOT BE CONCEALED BY CURTAINS, DRAPES, DECORATIONS OR SIMILAR MATERIALS (1010.1)
- THE REQUIRED CAPACITY OF EACH DOOR OPENING SHALL BE SUFFICIENT FOR THE OCCUPANT LOAD THEREOF AND SHALL PROVIDE A MINIMUM CLEAR OPENING WIDTH OF 32 INCHES (1010.1.1)
- THE CLEAR OPENING WIDTH OF THE DOORWAY SHALL BE MEASURED BETWEEN THE FACE OF THE DOOR AND THE STOP, WITH THE DOOR OPEN 90 DEGREES (1010.1.1)
- WHERE THIS SECTION REQUIRES A MINIMUM CLEAR OPENING WIDTH OF 32 INCHES AND A DOOR OPENING INCLUDES TWO DOOR LEAVES WITHOUT A MULLION, ONE LEAF SHALL PROVIDE A MINIMUM CLEAR OPENING WIDTH OF 32 INCHES (1010.1.1)
- THE MINIMUM CLEAR OPENING HEIGHT OF DOORS SHALL BE NOT LESS THAN 80 INCHES (1010.1.1) EXCEPT AS SPECIFICALLY PERMITTED BY THIS SECTION. EGRESS DOORS SHALL BE READILY OPERABLE FROM THE EGRESS SIDE WITHOUT THE USE OF A KEY OR SPECIAL KNOWLEDGE OR EFFORT (1010.1)
- DOOR HANDLES, PULLS, LATCHES, LOCKS AND OTHER OPERATING DEVICES ON DOORS REQUIRED TO BE ACCESSIBLE BY CHAPTER 11A OR 11B SHALL NOT REQUIRE TIGHT GRIPPING, TIGHT PUSHING OR TWISTING OF THE WRIST TO OPERATE (1010.2.2)
- DOOR HANDLES, PULLS, LATCHES, LOCKS AND OTHER OPERATING DEVICES SHALL BE INSTALLED 34 INCHES MINIMUM AND 48 INCHES MAXIMUM ABOVE THE FINISH FLOOR OR GROUND, WHERE SLIDING DOORS ARE IN THE FULLY OPEN POSITION, OPERATING HARDWARE SHALL BE EXPOSED AND USABLE FROM BOTH SIDES (11B-604.2.2)
- DOORS, DOORWAYS, AND GATES THAT ARE A PART OF AN ACCESSIBLE ROUTE SHALL COMPLY WITH SECTION 11B-604.1 (11B-604.1)
- HANDLES, PULLS, LATCHES, LOCKS AND OTHER OPERABLE PARTS ON DOORS AND GATES SHALL COMPLY WITH SECTION 11B-604.1. OPERABLE PARTS OF SUCH HARDWARE SHALL BE 24 INCHES MINIMUM AND 44 INCHES MAXIMUM ABOVE THE FINISH FLOOR OR GROUND, WHERE SLIDING DOORS ARE IN THE FULLY OPEN POSITION, OPERATING HARDWARE SHALL BE EXPOSED AND USABLE FROM BOTH SIDES (11B-604.2.2)
- A READILY MOBILE OUPABLE SIGN POSTED ON THE EGRESS SIDE ON OR ADJACENT TO THE DOOR STATING "THIS DOOR TO REMAIN UNLOCKED WHEN THIS SPACE IS OCCUPIED" THE SIGN SHALL BE IN LETTERS 1 INCH HIGH ON CONTRASTING BACKGROUND (1010.2.4.3.2)
- WHERE MORE THAN ONE EXIT, OR ACCESS TO MORE THAN ONE EXIT, IS REQUIRED, THE MEANS OF EGRESS SHALL BE CONFIGURED SUCH THAT THE LOSS OF ANY ONE EXIT, OR ACCESS TO ONE EXIT, SHALL NOT REDUCE THE AVAILABLE CAPACITY OR WIDTH TO LESS THAN 50 PERCENT OF THE REQUIRED CAPACITY OR WIDTH (1008.5)
- THE MEANS OF EGRESS SERVING A ROOM OR SPACE SHALL BE ILLUMINATED AT ALL TIMES THAT THE ROOM OR SPACE IS OCCUPIED (1008.2)
- THE MEANS OF EGRESS ILLUMINATION SHALL BE NOT LESS THAN 1 FOOTCANDLE (1 LUX) AT THE WALKING SURFACE, ALONG EXIT ACCESS STAIRWAYS, EXIT STAIRWAYS AND AT THE REQUIRED LANDINGS. THE ILLUMINATION LEVEL SHALL NOT BE LESS THAN 10 FOOTCANDLES (108 LUX) AT THE WALKING SURFACE WHEN THE STAIRWAY IS IN USE (1008.2.1)
- IN THE EVENT OF A POWER SUPPLY FAILURE IN BUILDINGS THAT REQUIRE 2 OR MORE EXITS OR ACCESS TO EXITS, AN EMERGENCY ELECTRICAL SYSTEM SHALL AUTOMATICALLY ILLUMINATE ALL OF THE FOLLOWING AREAS (1008.3.2)
 - INTERIOR EXIT ACCESS STAIRWAYS AND RAMPS
 - INTERIOR AND EXTERIOR EXIT STAIRWAYS AND RAMPS
 - EXIT PASSAGEWAYS
 - VESTIBULES AND AREAS ON THE LEVEL OF DISCHARGE USED FOR EXIT DISCHARGE IN ACCORDANCE WITH SECTION 1008.2
 - EXTERIOR LANDINGS AS REQUIRED BY SECTION 1010.1.5 FOR EXIT DOORWAYS THAT LEAD DIRECTLY TO THE EXIT DISCHARGE
- THE EMERGENCY POWER SYSTEM SHALL PROVIDE POWER FOR A DURATION OF NOT LESS THAN 90 MINUTES AND SHALL CONSIST OF STORAGE BATTERIES, UNIT EQUIPMENT OR AN ON-SITE GENERATOR. THE INSTALLATION OF EMERGENCY POWER SYSTEM SHALL BE IN ACCORDANCE WITH SECTION 2102 (1008.3.4)
- EMERGENCY LIGHTING FACILITIES SHALL BE ARRANGED TO PROVIDE INITIAL ILLUMINATION THAT IS NOT LESS THAN AN AVERAGE OF 1 FOOTCANDLE (1 LUX) AND A MINIMUM AT ANY POINT OF 0.1 FOOTCANDLE (1 LUX) MEASURED ALONG THE PATH OF EGRESS AT FLOOR LEVEL. ILLUMINATION LEVELS SHALL BE PERMITTED TO DEGRADE TO 0.6 FOOTCANDLE (6 LUX) AVERAGE AND A MINIMUM AT ANY POINT OF 0.06 FOOTCANDLE (0.6 LUX) AT THE END OF THE EMERGENCY LIGHTING TIME DURATION. A HAZARDOUS TO WORKING ILLUMINATION UNIFORMITY RATIO OF 40 TO 1 SHALL NOT BE EXCEEDED (1008.3.5)

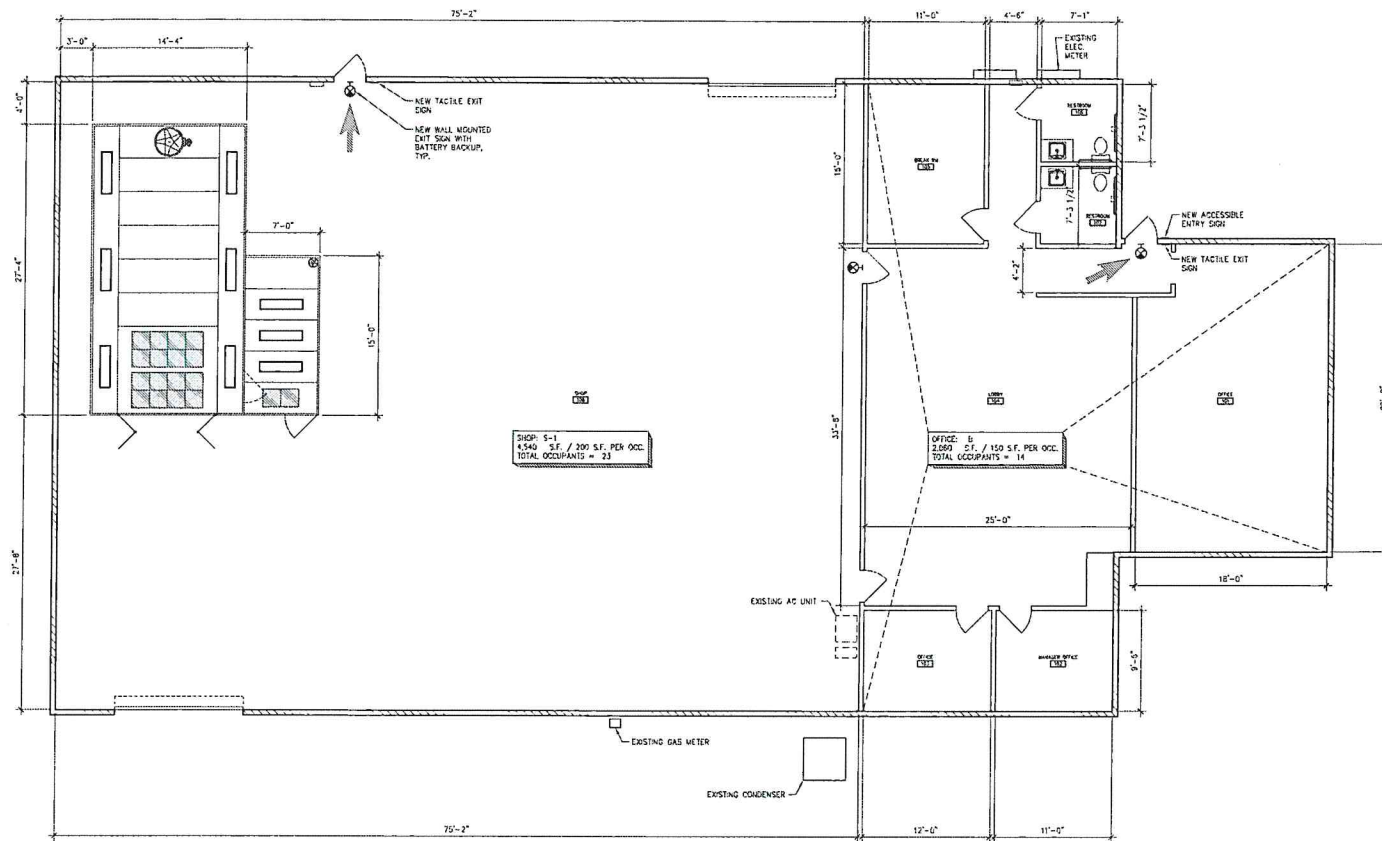

PROPOSED FLOOR PLAN

SCALE: 3/16" = 1'-0"

1

DATE	04/26/23
BY	RPD
DESCRIPTION	MAJOR DISCREPANCY POINT
DATE	04/26/23
BY	RPD
DESCRIPTION	MAJOR DISCREPANCY POINT

Prepared By: RPD INC. 1625 WEST ST. CAMDEN GROVE, CA 95824 CONTACT: RANDY OROZCO roro@rpdesign.com

Project For: EMERGENCY AUTO BODY 2831 LANIER LANE TURLOCK, CA 95369

STAMP: APPROVED FOR THE CITY OF TURLOCK DATE: 5/24/23

SHEET TITLE: OCCUPANCY


DATE: 04/26/23

SCALE: AS NOTED

DRAWN: P. OROZCO

JOB: -

SHEET NO: A5

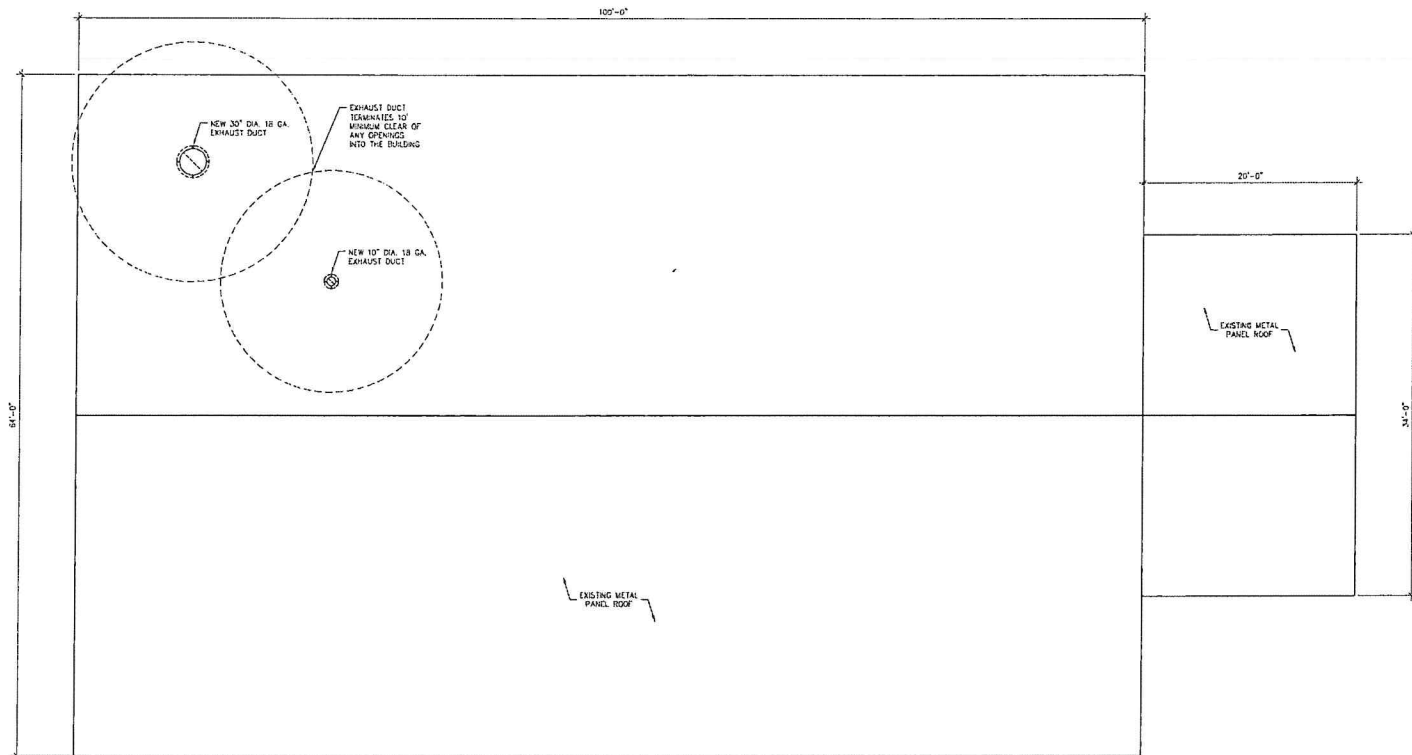


PROPOSED ROOF PLAN

SCALE: 3/16" = 1'-0"

1

PROJECT FOR: IMPERIAL AUTO BODY 2551 LASITER LANE TURLOCK, CA 95380		PROVIDED BY: RICHMONDS, INC. 1602 WEST ST. GARDEN GROVE, CA 92640 CONTACT: RANDY OROZCO EMAIL: rmh@richmondsign.com			
SHEET TITLE: PROPOSED ROOF PLAN		DATE: 04/28/23		DATE: 05/24/23	
SCALE: AS NOTED		DESCRIPTION: WHOLE DISCRETIONARY PERMIT		BY: RPD	
DRAWN: P. OROZCO		DATE: 05/24/23		DATE: 05/24/23	
JOB: -		DESCRIPTION: -		DATE: -	
SHEET NO. A6		DESCRIPTION: -		DATE: -	


THIS DRAWING & SPECIFICATIONS ARE THE PROPERTY & COPYRIGHT OF RPD DESIGN & SHALL NOT BE USED ON ANY OTHER WORK WITHOUT WRITTEN PERMISSION. RPD DESIGN SHALL HAVE NO LIABILITY FOR ANY DAMAGE TO THE WORK OR THE DESIGNER SHALL BE RESPONSIBLE TO THE USER OF THE DESIGN FROM THE DATE OF ANY WORK.

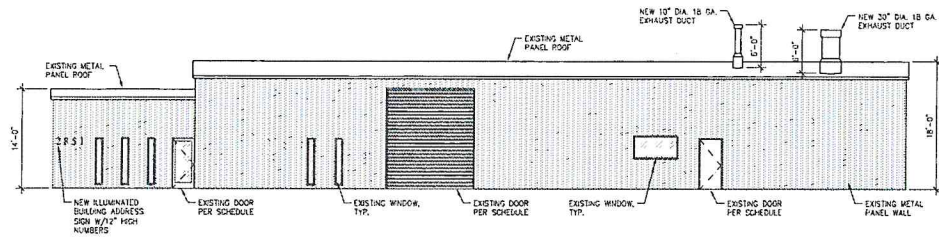

EAST ELEVATION

SCALE: 1/8" = 1'-0"


2

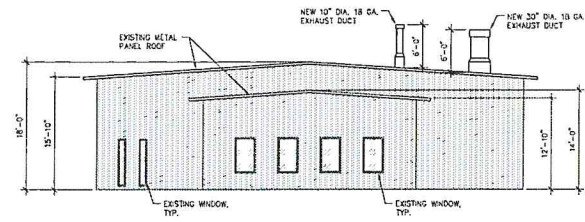

SOUTH ELEVATION

SCALE: 1/8" = 1'-0"


1

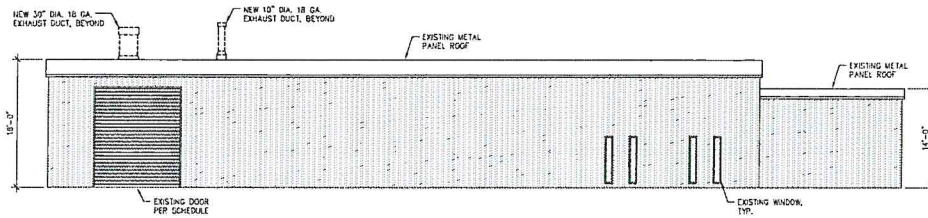

WEST ELEVATION

SCALE: 1/8" = 1'-0"

4

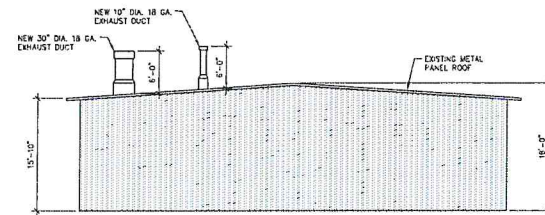

NORTH ELEVATION


SCALE: 1/8" = 1'-0"

3

Prepared By: RTO DESIGNS INC. 11662 WEST ST. GARDEN GROVE, CA 92640 TEL: (714) 644-6770 EMAIL: rto@rto designs.com		Project For: INTERDUZ AUTO BODY 2551 LASTER LANE TURLOCK, CA 95380	
Project No: 5/24/23		SHEET TITLE: EXTERIOR ELEVATIONS	
DATE: 04/26/23		SCALE: AS NOTED	
DRAWN: P. BROZCIC		JOB: -	
SHEET NO. A7		DATE: 02/21/23 BY: RPD DESCRIPTION: UNIFORM DISCRETIONARY PERMIT	
DATE: 02/21/23 BY: RPD DESCRIPTION: UNIFORM DISCRETIONARY PERMIT		DATE: 02/21/23 BY: RPD DESCRIPTION: UNIFORM DISCRETIONARY PERMIT	




THESE DRAWINGS & SPECIFICATIONS ARE THE PROPERTY & COPYRIGHT OF RTO DESIGNS & SHOULD NOT BE USED ON ANY OTHER WORK WITHOUT WRITTEN PERMISSION. ANY REPRODUCTION OR TRANSMISSION OF THESE DRAWINGS WITHOUT WRITTEN PERMISSION SHALL BE PROHIBITED. ANY VIOLATION SHALL BE PROSECUTED TO THE FULL EXTENT OF THE LAW.

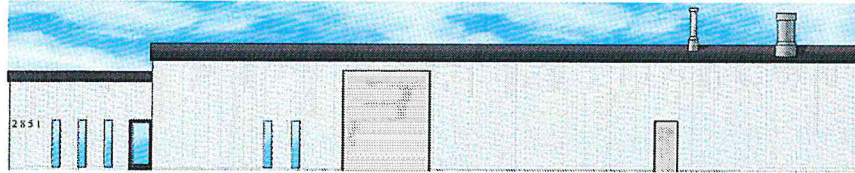

EAST ELEVATION
SCALE: 1/8" = 1'-0"

2

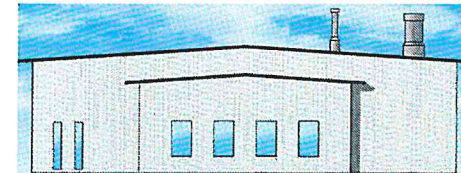


SOUTH ELEVATION
SCALE: 1/8" = 1'-0"

1



WEST ELEVATION
SCALE: 1/8" = 1'-0"

4

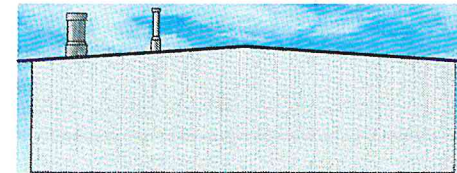


NORTH ELEVATION
SCALE: 1/8" = 1'-0"

3


STAMP		DATE	BY	DESCRIPTION	DATE	BY
		04/26/23		MAJOR DISCRETIONARY PERMIT	02/24/23	
Project For: INTERDUZ AUTO BODY 2851 LASTER LANE TURLOCK, CA 95380		Prepared By: RHOADS INC. 1162 WEST ST. GARDEN GROVE, CA 92640 TEL: (714) 946-6070 EMAIL: rnh@rho-inc.com				
SHEET TITLE: COLOR RENDERINGS						
DATE: 04/26/23						
SCALE: AS NOTED						
DRAWN: P. OROZCO						
JOB: -						
SHEET NO: A8						

THESE DRAWINGS & SPECIFICATIONS ARE THE PROPERTY & COPYRIGHT OF RHOADS INC. & SHALL NOT BE USED ON ANY OTHER WORK WITHOUT THE WRITTEN PERMISSION OF RHOADS INC. ANY VIOLATION SHALL BE REPORTED TO THE BOARD OF ARCHITECTS. RHOADS INC. SHALL BE RESPONSIBLE FOR THE ACCURACY OF THE INFORMATION PROVIDED HEREON.

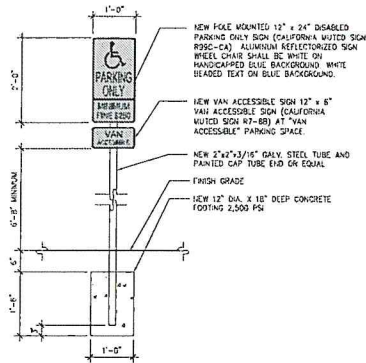


VAN ACCESSIBLE PARKING SIGN

SCALE: 3/4"=1'-0"

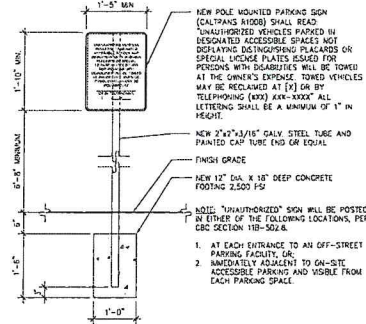


UNAUTHORIZED PARKING SIGN

SCALE: 3/4"=1'-0"

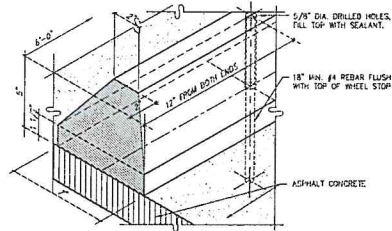


CONCRETE WHEEL STOP

SCALE: NOT TO SCALE

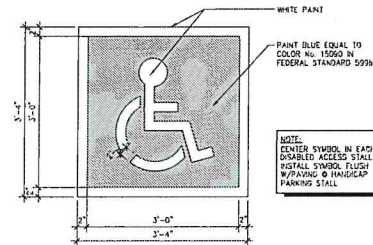

ACCESSIBLE PAVEMENT STALL SIGNAGE

SCALE: 1"=1'-0"




ACCESSIBLE ENTRY SIGNAGE

SCALE: 6"=1'-0"

KEYNOTES:

- 1 NEW 4" WIDE STRIPED ACCESSIBLE PAINTED BLUE
- 2 NEW 4" WIDE STRIPED PARKING STALL PAINTED BLUE
- 3 NEW PAINTED "NO PARKING" IN WHITE LETTERS NO LESS THAN 12" HIGH
- 4 NEW 4" WIDE STRIPED PARKING STALL PAINTED WHITE.

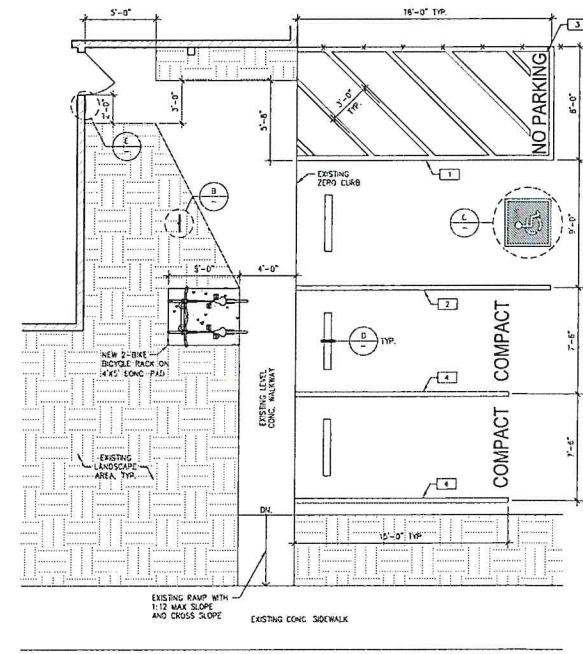

ACCESSIBLE PARKING PLAN

SCALE: 1/4"=1'-0"

DATE	DESCRIPTION	BY	DATE	DESCRIPTION	BY
05/24/23	MAJOR DISCREPANCY PERMIT	RFD			

PROJECT FOR:	PROPOSED BY:
IMPERIAL AUTO BODY	IMPERIAL AUTO BODY
2851 LASTER LANE	1162 WEST ST.
TURLOCK, CA 95380	GARDEN GROVE, CA 92640
	TEL: 949.444.4444
	EMAIL: rmb@imperialdesign.com

STAMP	DATE: 5/24/23
APPROVED BY:	
DATE: 5/24/23	

SHEET TITLE:	DATE: 04/28/23
ACCESSIBLE PARKING PLAN & SITE DETAILS	SCALE: AS NOTED
	DRAWN: P. ORIOZCO
JOB: -	
SHEET NO.	
AD1	

THIS DOCUMENT IS THE PROPERTY OF THE U.S. GOVERNMENT AND IS NOT TO BE DISTRIBUTED OUTSIDE THE U.S. GOVERNMENT. IT IS TO BE KEPT IN THE SAFE OF THE U.S. GOVERNMENT.	DATE: 04/26/23 SCALE: AS NOTED DRAWN: P. PROZCO SHEET NO. EQ2	STAMP APPROVED FOR RELEASE DATE: 5/14/23	PROJECT FOR: INTERVUO AUDIO BODY 2851 LASTER LANE TURLOCK, CA 95380	Prepared By: INTERVUO INC. GARDINGBOW/CANON CONTACT: RANDY PROZCO TEL: 714/9646470 EMAIL: randy@proco.com		DESCRIPTION	BY	DATE	IN
						MAJOR RESECTION/REPAIR	APG	06/24/23	

NFPA 33:

CHAPTER 8 STORAGE, HANDLING AND DISTRIBUTION OF FLAMMABLE AND COMBUSTIBLE LIQUIDS

8.1 GENERAL. STORAGE, HANDLING AND MIXING OF FLAMMABLE AND COMBUSTIBLE LIQUIDS SHALL MEET ALL THE APPLICABLE REQUIREMENTS OF NFPA 30 OF THIS CHAPTER.

8.2 STORAGE PROCESS AREAS.

8.2.1 THE VOLUME OF CLASS I, CLASS II AND CLASS IIIA LIQUIDS STORED IN A STORAGE CABINET SHALL NOT EXCEED 454 L (120 GAL).

8.2.1.1 THE TOTAL AGGREGATE VOLUME OF CLASS I, CLASS II AND CLASS IIIA LIQUIDS IN A GROUP OF STORAGE CABINETS SHALL NOT EXCEED THE MAXIMUM ALLOWABLE QUANTITY OF FLAMMABLE AND COMBUSTIBLE LIQUIDS PER CONTROL AREA BASED ON THE OCCUPANCY WHERE THE CABINETS ARE LOCATED, AS SET FORTH IN SECTION 9.6 OF NFPA 30.

8.2.1.2 FOR INDUSTRIAL OCCUPANCIES, THE TOTAL AGGREGATE VOLUME OF CLASS I, CLASS II AND CLASS IIIA LIQUIDS IN A GROUP OF STORAGE CABINETS IN A SINGLE AREA SHALL NOT EXCEED THE MAXIMUM ALLOWABLE QUANTITY (MAQ) OF FLAMMABLE AND COMBUSTIBLE LIQUIDS PER CONTROL AREA FOR INDUSTRIAL OCCUPANCIES AS SET FORTH IN TABLE 8.2.1.2.

8.2.2 THE QUANTITY OF LIQUID LOCATED IN THE VICINITY OF SPRAYING OPERATIONS BUT OUTSIDE OF IDENTIFIED STORAGE AREAS, SUCH AS STORAGE CABINETS, AN INSIDE LIQUID STORAGE AREA, OR A WAREHOUSE OR OUTSIDE OF OTHER SPECIFIC PROCESS AREAS THAT ARE CUT OFF BY AT LEAST A 2-HOUR FIRE SEPARATION FROM THE SPRAYING OPERATIONS, SHALL NOT EXCEED THE QUANTITY GIVEN IN EITHER OF THE FOLLOWING, WHICHEVER IS GREATER.

(1) THE AMOUNT REQUIRED TO SUPPLY SPRAYING OPERATIONS FOR ONE CONTINUOUS 24-HOUR PERIOD.

(2) THE AGGREGATE SUM OF THE FOLLOWING:

(a) 95 L (25 GAL) OF CLASS IA LIQUIDS IN CONTAINERS.

(b) 454 L (120 GAL) OF CLASS IB, CLASS IC, CLASS II OR CLASS III LIQUIDS IN CONTAINERS.

(c) 6,000 L (1,585 GAL) OF EITHER OF THE FOLLOWING:

i. CLASS IB, IC, II OR IIIA LIQUIDS IN METAL PORTABLE TANKS OR METAL INTERMEDIATE BULK CONTAINERS, EACH NOT EXCEEDING 3,000 L (793 GAL).

ii. CLASS II OR CLASS IIIA LIQUIDS IN NONMETALLIC INTERMEDIATE BULK CONTAINERS, EACH NOT EXCEEDING 3,000 L (793 GAL).

(d) TWENTY PORTABLE TANKS OR INTERMEDIATE BULK CONTAINERS, EACH NOT EXCEEDING 3,000 L (793 GAL) OF CLASS IIIB LIQUIDS.

8.2.3 THE QUANTITY OF FLAMMABLE AND COMBUSTIBLE LIQUIDS LOCATED IN A SPRAY AREA OR IN A MIXING ROOM ADJACENT TO A SPRAY AREA SHALL MEET THE REQUIREMENTS OF SECTION 8.3.

8.3 MIXING.

8.3.1 DISPENSING OR TRANSFER OF LIQUIDS FROM CONTAINERS AND FILLING OF CONTAINERS, INCLUDING PORTABLE MIXING TANKS AND "PRESSURE POTS," SHALL BE DONE ONLY IN A SPRAY AREA WITH THE VENTILATION IN OPERATION OR IN A MIXING ROOM.

8.3.2 WHERE THE QUANTITIES OF LIQUIDS REQUIRED OR THE FLOOR AREA NECESSARY TO PROVIDE A SUITABLE MIXING ROOM EXCEEDS THE LIMITS SPECIFIED IN 8.3.3 THROUGH 8.3.6, THE MIXING ROOM SHALL MEET ALL APPLICABLE REQUIREMENTS OF NFPA 30.

8.3.3 MIXING ROOMS SHALL MEET ALL OF THE FOLLOWING REQUIREMENTS:

(1) MIXING ROOMS SHALL MEET THE CONSTRUCTION REQUIREMENTS OF SECTION 5.1.

(2) THE AREA OF A MIXING ROOM SHALL NOT EXCEED 14 M² (150 FT²).

(3) IF MORE THAN ONE MIX ROOM IS INSTALLED, THE TOTAL QUANTITY OF LIQUIDS SHALL NOT EXCEED THE LIMITS IN 8.3.5 OR 8.3.6.

(4) MIXING ROOMS SHALL BE DESIGNED TO CONTAIN A SPILL OF THE CONTENTS IN THE ROOM.

(5) MIXING ROOMS SHALL BE PROVIDED WITH CONTINUOUS MECHANICAL VENTILATION CAPABLE OF PROVIDING AIR MOVEMENT OF NOT LESS THAN 0.3 M³/MIN PER SQUARE METER OF FLOOR AREA (1 FT³/MIN/FT²) OR 4 M³/MIN (150 FT³/MIN), WHICHEVER IS GREATER. THE VENTILATION SYSTEM SHALL BE IN OPERATION AT ALL TIMES.

(6) THE MIXING ROOM AIR MAKE-UP SYSTEM AND EXHAUST SYSTEM SHALL REMAIN FUNCTIONING DURING ANY FIRE ALARM CONDITION IN ACCORDANCE WITH SECTION 9.3.

(7) MIXING ROOMS SHALL BE CLASSIFIED, FOR PURPOSES OF ELECTRICAL AREA CLASSIFICATION, THE SAME AS ENCLOSED SPRAY BOOTHS, IN ACCORDANCE WITH 6.5.4.


(8) MIXING ROOMS SHALL BE PROVIDED WITH AN APPROVED AUTOMATIC FIRE PROTECTION SYSTEM THAT MEETS ALL APPLICABLE REQUIREMENTS OF CHAPTER 9.

(9) MIXING ROOMS SHALL BE PROVIDED WITH PORTABLE FIRE EXTINGUISHERS LOCATED IN ACCORDANCE WITH NFPA 10.

8.3.4 THE AMOUNT OF LIQUID PERMITTED IN A SINGLE SPRAY AREA SHALL NOT EXCEED 227 L (60 GAL).


8.3.5 WHERE A SEPARATE MIXING ROOM IS PROVIDED AND THE MIXING ROOM IS LOCATED ADJACENT TO OR WITHIN 1,830 MM (6 FT) OF AN ADJACENT SPRAY AREA OR AREAS, AS SHOWN IN FIGURE 8.3.5(a) AND FIGURE 8.3.5(b), THE COMBINED QUANTITIES OF LIQUIDS LOCATED IN THE SPRAY AREAS AND THE MIXING ROOM SHALL NOT EXCEED 454 L (120 GAL).

8.3.6 WHERE A SEPARATE MIXING ROOM IS PROVIDED AND THE MIXING ROOM IS LOCATED MORE THAN 1,830 MM (6 FT) FROM AN ADJACENT SPRAY AREA OR AREAS, THE QUANTITY OF LIQUID PERMITTED IN THE MIXING ROOM SHALL NOT EXCEED 80 L/M² (2 GAL/FT²), UP TO A MAXIMUM OF 1,135 L (300 GAL), AS SHOWN IN FIGURE 8.3.6. THE AMOUNT OF LIQUID IN THE SPRAY AREA SHALL NOT EXCEED 227 L (60 GAL).




MAXIMUM VOLUMES OF LIQUID ALLOWED:
SPRAY AREA, 227 L (60 GAL)
SPRAY AREA AND MIX ROOM, 454 L (120 GAL)

FIGURE 8.3.5(a) MIXING ROOM WITHIN 1,830 MM (6 FT) OF SPRAY AREA, INCLUDING MAXIMUM VOLUME OF LIQUID ALLOWED.



MAXIMUM VOLUMES OF LIQUID ALLOWED:
SPRAY AREA, 227 L (60 GAL)
SPRAY AREA AND MIX ROOM, 454 L (120 GAL)

FIGURE 8.3.5(b) MIXING ROOM WITHIN 1,830 MM (6 FT) OF SPRAY AREA AND WITH DIRECT ENTRY TO SPRAY AREA, INCLUDING MAXIMUM VOLUME OF LIQUID ALLOWED.

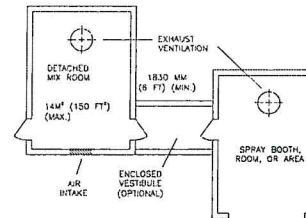

MAXIMUM VOLUMES OF LIQUID ALLOWED:
SPRAY AREA, 227 L (60 GAL)
SPRAY AREA AND MIX ROOM, 1,352 L (360 GAL)

FIGURE 8.3.6 MIXING ROOM MORE THAN 1,830 MM (6 FT) FROM SPRAY AREA, INCLUDING MAXIMUM VOLUME OF LIQUID ALLOWED.

DATE	DESCRIPTION	BY	DATE	DESCRIPTION	BY
05/24/23	MAJOR CORRECTIONS PERMIT				




Prepared By:
 RICHARDSON INC.
 1162 WEST ST.
 GARDEN GROVE, CA 92640
 TEL: 714/441-0000
 FAX: 714/441-0001
 EMAIL: rmd@rdndesign.com

Project For:
 IMPERIAL AUTO BODY
 2831 LASTER LANE
 TULUOK, CA 95380

STAMP
 APPROVED FOR
 DATE OF REVIEW
 5/24/23

SHEET TITLE:
 NOTE: PARENT MIX ROOM

DATE: 04/28/23
 SCALE: AS NOTED
 DRAWN: P. ORZELLO
 JOB: -
 SHEET NO.
EQ3



Project for: INTERMODIAZ AUTO BODY 1600 WEST ST. CLACKAMAS, WA 98040 TUBULINE, CA 95399		Prepared by: PROFESSIONALS INC. 1000 WEST ST. CLACKAMAS, WA 98040 CONSTANT RANDY ORUZCO TEL.: (206) 564-6470 EMAIL: randy@profsinc.com		RPO RPO RPO		Description: MAJOR DESCRIPTION: INTERMODIAZ		Date: 05/24/23		By: RPO		Date: 05/24/23		IP:	
Project for: INTERMODIAZ AUTO BODY 1600 WEST ST. CLACKAMAS, WA 98040 TUBULINE, CA 95399															
STAMP LICENSED PROFESSIONAL RPO 5/24/23															
SHEET TITLE: EQUIPMENT DETAILS															
DATE: 04/28/23 SCALE: AS NOTED DRAWN BY: P. ORUZCO JOB: - SHEET NO: EQ5															